NOTES:

1. STUB 2" CONDUITS UP TO PANEL L1A IN PRESS BOX.
2. PROVIDE #10 AWG CONDUCTORS FOR ENTIRE CIRCUIT.
3. EXTEND (2) 2" SPARE CONDIUTS FROM LOCATION SHOWN TO PANEL L1A IN THE PRESS BOX.
4. PROVIDE 16" X 16" QUAZITE BOX.
5. PROVIDE 1" CONDUIT WITH ONE PAIR SHIELDED #22 AWG CABLE FROM SCOREBOARD TO CONTROL CONSOLE IN PRESS BOX.

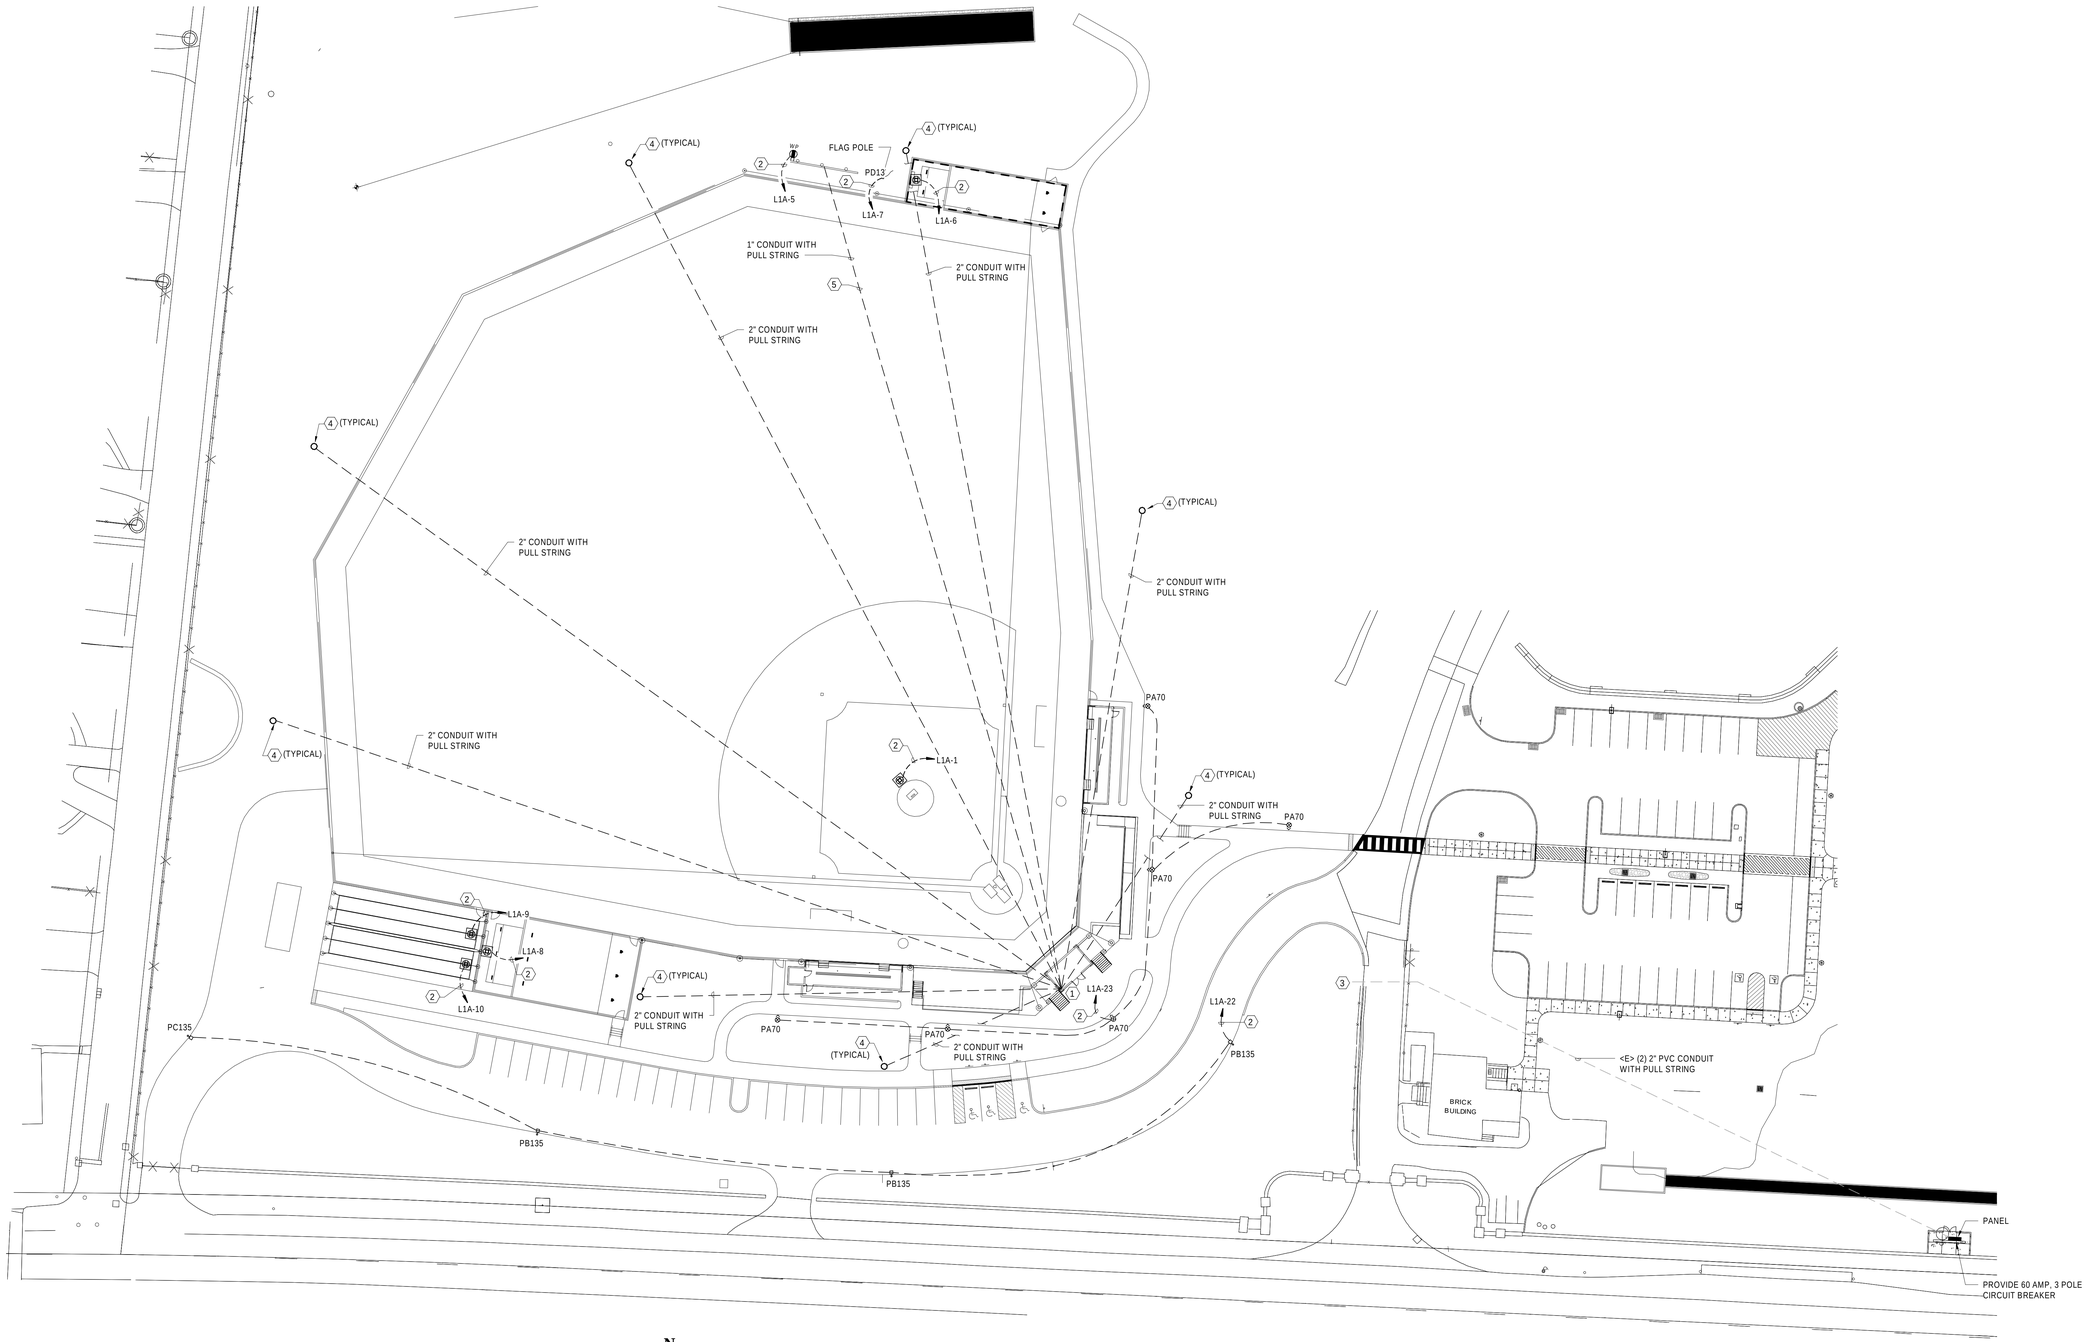

N

1 SITE PLAN
SCALE: 1" = 30'-0"

NOT FOR CONSTRUCTION

PennsylvaniaOffice
2675 Eastern Blvd
York, PA 17402
717.755.1560
MarylandOffice
913 Ridgebrook Road
Sparks, MD 21152
443.633.1681
www.jdbengineering.com
jdb engineering, inc.

DERCK & EDSON
EST. 1960
CAMPUSES DOWNTOWNS ATHLETICS
33 SOUTH BROAD STREET, LITITZ PA 17543
301 N SPRING STREET, SUITE 203, BELLEFONTE, PA 16823
WWW.DERCKANDEDSON.COM (717)626-2004

SITE PLAN

AMENDED PRELIMINARY / FINAL SITE DEVELOPMENT PLAN

FAIRLEIGH DICKINSON ATHLETIC FIELDS

FAIRLEIGH DICKINSON UNIVERSITY
LOT 6 / BLOCK 101 - ZONE: UNIVERSITY
285 MADISON AVENUE, MADISON, NJ 07940
MADISON BOROUGH, MORRIS COUNTY, NEW JERSEY

REVISIONS:

No.	DATE	DESCRIPTION OF CHANGES

DATE: 08/06/2020
PROJECT #: 190450
DRAWN BY: JST
PM: BEP
PIC: BEP

DRAWING NO.

E001

4/16/2020 10:55:40 AM